


Mayor
Shari L. Buck

Acting City Manager
Maryann Ustick

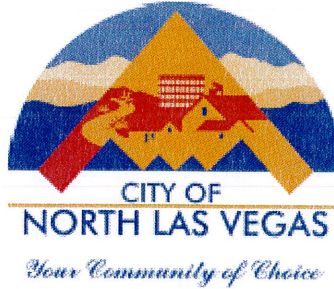

Council Members
William I. Robinson
Robert L. Eliason
Anita G. Wood
Richard J. Cherchio

Utilities Department – David H. Bereskin, P.E., Director

2829 Fort Sumter Dr. • North Las Vegas, Nevada 89030
Telephone: (702) 633-1275 • Fax: (702) 649-9784 • TDD (800) 326-6868
www.cityofnorthlasvegas.com

ADDENDUM NO. 2
BID NO. 1375
LOSEE SEWER LINE – PHASE 2A ALEXANDER TO MENDENHALL
ISSUE DATE: 9/20/10

THE BIDDER SHALL ACKNOWLEDGE RECEIPT OF THIS ADDENDUM UNDER THE FIRST ADDENDUM LINE ON THE FIRST PAGE OF THE BID PROPOSAL.

The following are changes and/or clarifications to the contract documents, specifications and drawings for the above referenced project.

Comment 1

Bid Item 203.04 – Remove Sewer Manhole has a bid quantity of 18 each. The plans only show 17 each. However, it appears that there is an existing manhole at station 167+27.52 that does not have a call out for removal but a removal will be necessary to complete the planned work.

Response 1

Please reference sheets U-01, U-02, U-03 and U-04. Note 5 calls out; "Remove Sewer Manhole". There are a total of (18) SSMH removals - (4) on sheet U-01, (4) on sheet U-02, (6) on sheet U-03 and (4) on sheet U-04.

Comment 2

Reference the existing manhole at station 195+51.48 on the profile view on Sheet U-04. There is no lateral shown connecting to this manhole, or to the new manhole SSMH L02-17 at the same location.

On the profile view of the existing manhole, there is an indication that there is a lateral from an unknown location connecting to the manhole.

Does the City have any information regarding the sewer laterals at this location?

ADDENDUM NO. 2
BID NO. 1375
LOSEE SEWER LINE – PHASE 2A ALEXANDER TO MENDENHALL
ISSUE DATE: 9/15/10

Response 2


There is not an existing sewer lateral connecting to the existing manhole at station 195+51.48. Therefore, the existing lateral shown on the profile for Sheet U-04 is incorrect.

Comment 3

Based on the project plans, specifications, Standard Specifications and Details, is Type II Aggregate Base acceptable for use in the pipe zone?

Response 3

Please reference Section 3.13 and SD-18 of the Design and Construction Standards for Wastewater Collection Systems. Please note that CLSM backfill is required for the top two (2) feet of the trench immediately below the bottom of the pavement per Section 3.13.5 subsection c.2.



CURT KROEKER, P.E.
Associate Engineer/Utilities